

EXHIBIT C


BCSD Standard Telecommunications Cable Labeling Scheme

The specification below is the cable labeling scheme required for BCSD voice, data, fiber, etc. cabling installations as of 9/7/12.

Includes labeling the following:

- Racks with closet designation
- Patch panel jacks
- Cable (patch end)
- Drop box
- Jack
- Cable (jack end)

As per the following methodology – to install a jack in room C40:

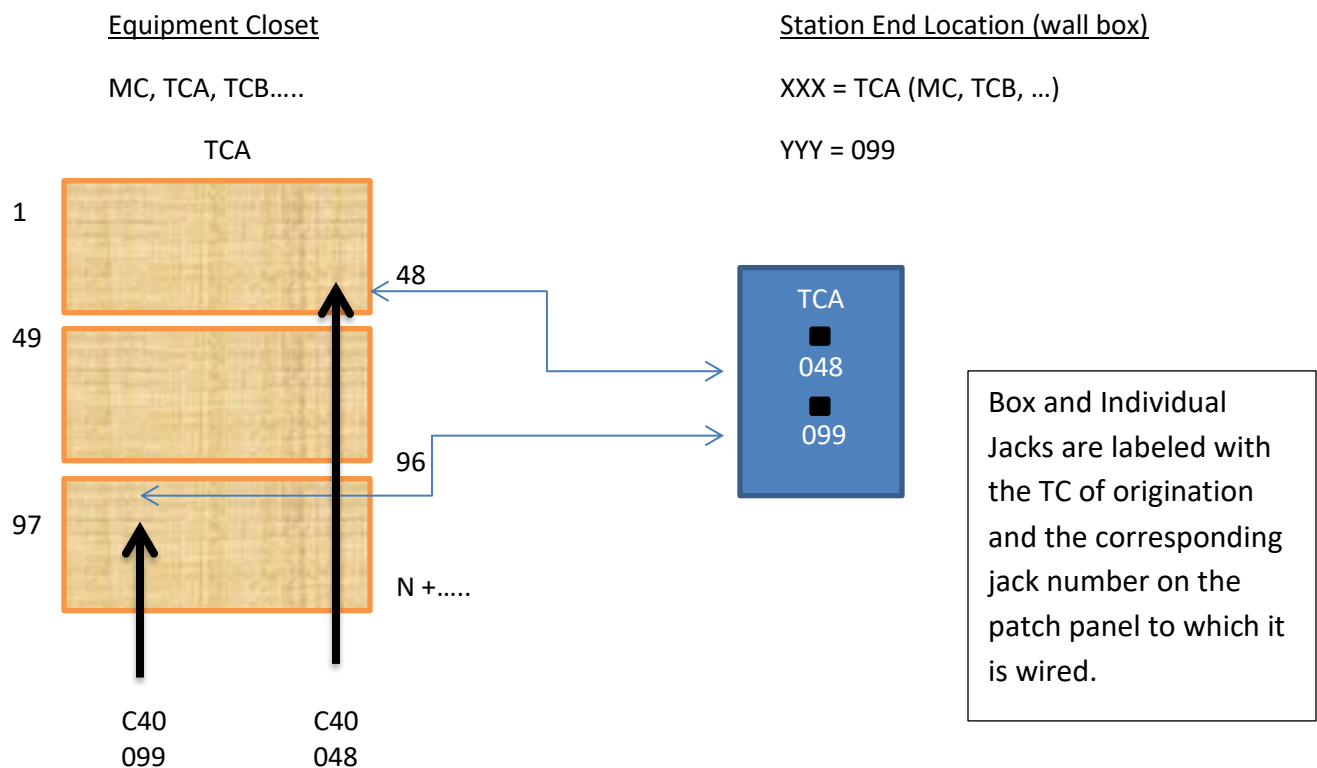

Patch panels are numbered left to right starting with 1 (upper left) to include the room number that the CO is located in and number of the patch panel jack as it would be sequentially on the patch panels located in the TC.

Cables should be labeled on both ends as per EIA/TIA 606.